


NOTE: SEE DETAIL WW-1 FOR INFO NOT SHOWN HERE

CROWN ELEV. 0.2' ABOVE CROWN ELEV. OF MH OUTLET PIPE OR AS DIRECTED BY ENGINEER

FORMED INVERT

12" MIN.

PARTIAL SECTION

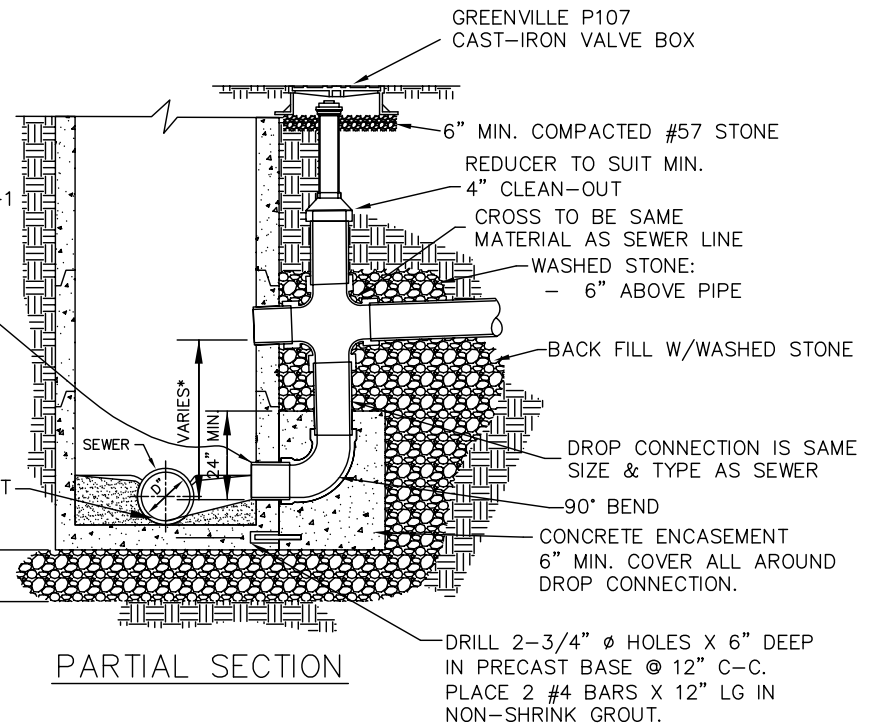

GREER COMMISSION OF PUBLIC WORKS TYPICAL PRECAST DROP MANHOLE (TYPE 3) WITH EXTERNAL CLEAN-OUT

APPROVED BY:

--

SCALE:

NTS



DATE:

FEBRUARY 2021

REVISED:

--

DRAWING NO.

WW-6