



NOTE:  
ON NEW PIPE INSTALLATIONS, TRANSITION  
FROM PVC TO DIP AND DIP TO PVC  
SHALL BE MADE WITH GASKETED, PVC  
SLIP-JOINT COUPLINGS. MISSION  
COUPLINGS ARE ONLY APPROVED FOR USE  
IN MAKING PIPING REPAIRS, NOT FOR  
TRANSITIONS IN NEW PIPE INSTALLATIONS.

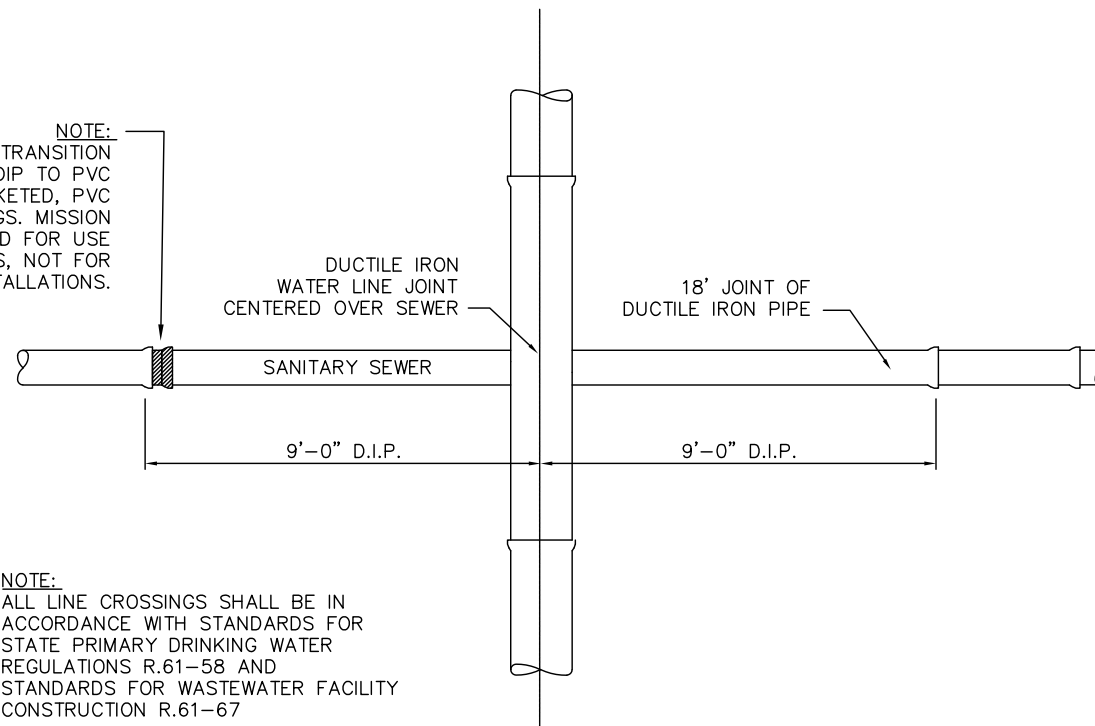

NOTE:  
ALL LINE CROSSINGS SHALL BE IN  
ACCORDANCE WITH STANDARDS FOR  
STATE PRIMARY DRINKING WATER  
REGULATIONS R.61-58 AND  
STANDARDS FOR WASTEWATER FACILITY  
CONSTRUCTION R.61-67

PLAN VIEW

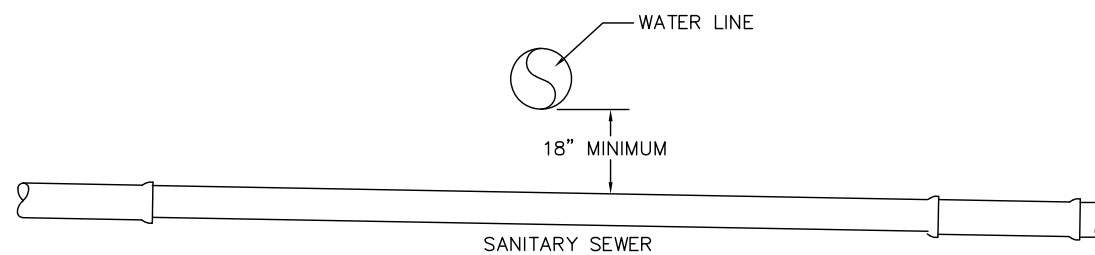

SECTION VIEW

**GREER COMMISSION OF PUBLIC WORKS**  
SANITARY SEWER AND  
WATER LINE CROSSING

APPROVED BY:

--

SCALE:

NTS



DATE:

FEBRUARY 2021

REVISED:

--

DRAWING NO.

W-1