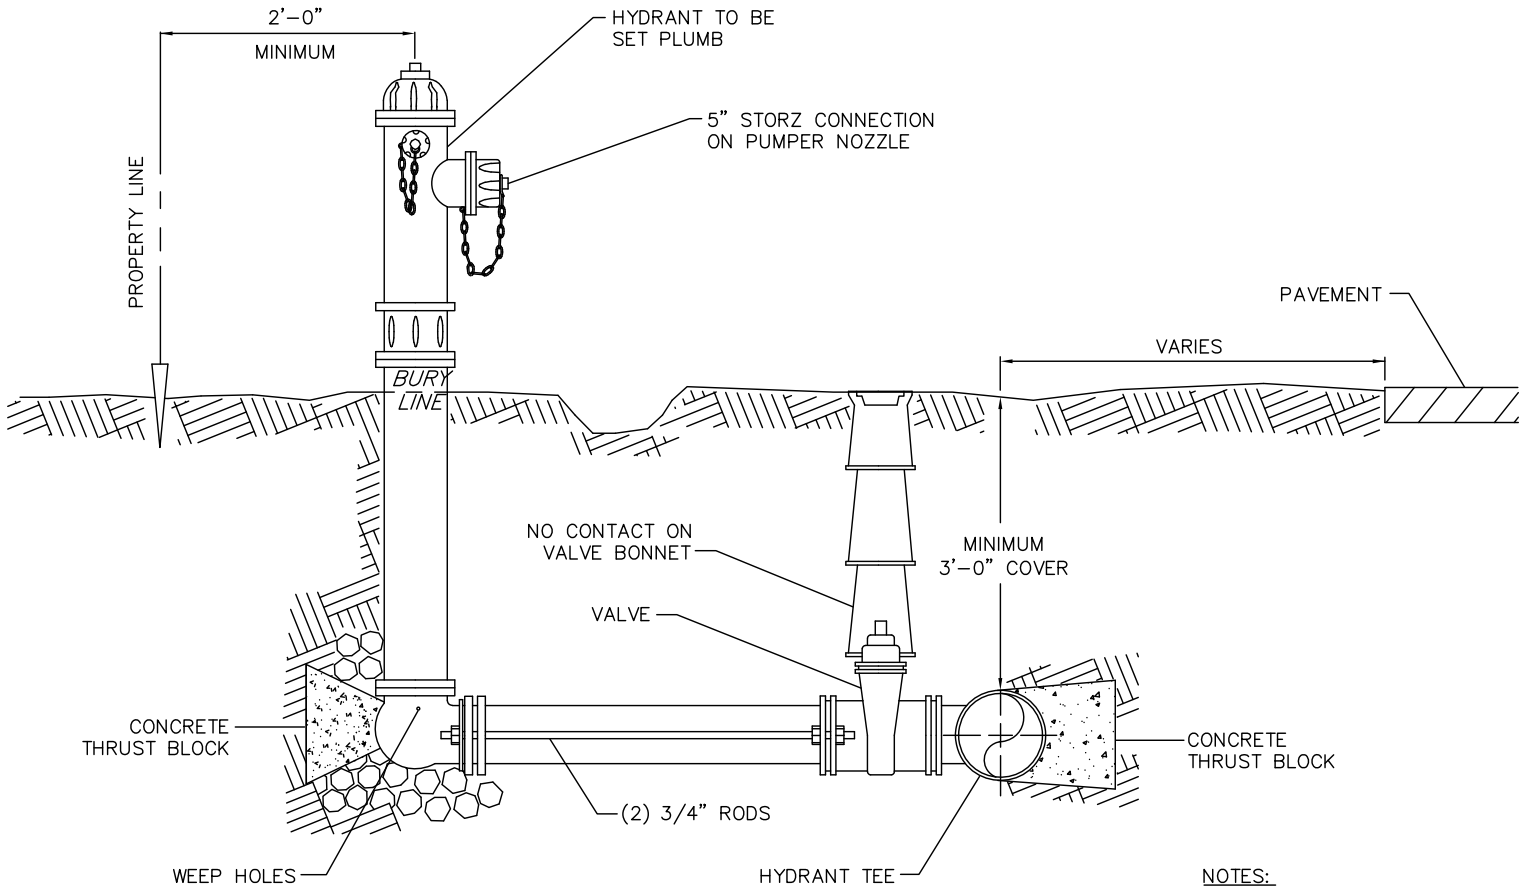

PLACE GRAVEL TO 6" ABOVE WEEP HOLES, 18" BELOW WEEP HOLES AND 18" TOWARDS THE MAIN. ALSO 16" LATERALLY ON EACH SIDE.

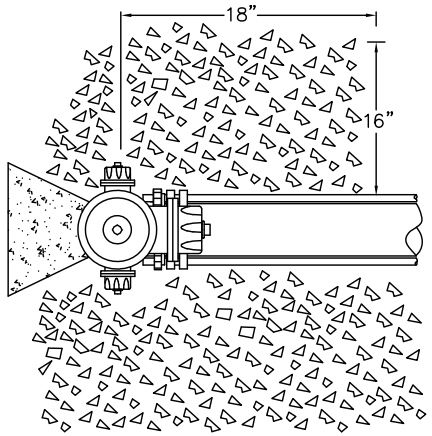

PLAN

NOTES:

1) RODS TO BE MADE OF STEEL HAVING A TENSILE STRENGTH OF 95,000 P.S.I.

2) AFTER INSTALLATION, ALL STEEL COMPONENTS, INCLUDING RODS, STRAPS, NUTS, BOLTS, COUPLINGS AND CLAMPS SHALL BE COATED WITH 17.5 MILS OF KOPPERS BITUMASTIC 300–M OR EQUAL.

3) MEG–A–LUGS MAY BE USED IN LIEU OF RODS.

4) THE FOLLOWING FIRE HYDRANTS ARE APPROVED PRODUCTS:
   – MUELLER COMPANY (SUPER CENTURION A423)

GREER COMMISSION OF PUBLIC WORKS

TYPICAL FIRE HYDRANT INSTALLATION DETAIL

APPROVED BY:		DATE:	DRAWING NO.
--		FEBRUARY 2021	W-10
SCALE: NTS		REVISED: --	